

# Optimal LIB/STATCOM Control Methodologies for Power Quality Improvement in a grid Connected WES

Ch. Sri Mrudula, PG Scholar, Department of EEE St. Peter's Engineering College, Hyderabad, India

Dr. K. Sreelatha, Professor & Head, Department of EEE St. Peter's Engineering College, Hyderabad, India

**Abstract**— The Now India increasingly choosing to replace fossil fuels with renewable energy sources. Among the factors driving people to preemptively seek out different sources of energy are fears about a reliance on fossil-fuel imports, resource depletion, and anthropogenic climate change. The renewable energy sources, particularly 'Wind Energy' development, showed its remarkable growth in the recent years, that can create pollution less and environment friendly atmosphere. India, over the years, has been a trend-setting nation with regard to Wind Power Utilization and decades of concentrated efforts have started to yield gratifying results. The Indian Wind Energy program has been very successful in commercializing wind energy and India stands 5th in the World in terms of installed wind power capacity of 19832 MW as on June 2013, contributes to around 75% of the grid-connected renewable energy power in the country. The wind energy market is continuing to grow steadily in India along with the rest of the world. India is now one of the global manufacturing hubs for wind turbines with about 23 large wind turbine manufacturers, capacity ranging from 225 kW to 2500 kW and several small wind turbine manufacturers producing capacity ranging from 300 W to 50 kW.

Energy resources have always played an important role in the development of human society. Since the industrial revolution the energy has been a driving force for the modern civilization development. A pressing demand for more electric power coupled with depleting natural resources has led to an increased need for energy production from renewable energysources such as wind and solar. The latest technological advancements in wind energy conversion and an increased support from governmental and private institutions have led to increased wind power generation in recent years. Wind power is the fastest growing renewable source of electrical energy. Integrating the wind energy into the grid impacts the power quality due to continuously varying wind speed components.

**Keywords**— LIB Li-ion battery energy storage; Nano Scale; PQ power quality; STATCOM;

## I. Introduction

There is a current global need for clean and renewable energy sources where renewable energy sources can curb our need for fossil fuels. Fossil fuels are non-renewable and require finite resources, which are dwindling because of high cost and environmentally damaging retrieval techniques. So, the need for cheap and obtainable resources is greatly needed. The efficient and more feasible alternative option is solar, wind etc. Nano technology is the best tool for achieving breakthrough in Li-ion battery electrode material. In order to improve the performance of batteries it is desired to develop

high energy density cathode materials using Nano materials. Now a day's Lead acid batteries have been used for solar electric systems but Li-ion offers higher energy density, longer cycle life, and no memory effect compared to lead acid batteries. [1]-[2]

A conventional STATCOM is a shunt-connected device which consists of a Voltage Source Inverter (VSI) and a dc capacitor. Since the dc capacitor is not a bulk energy storage device, the STATCOM does not have the ability of active power compensation. If an energy storage system, such as a Optimal Li-ion battery, is connected to the dc capacitor, the power regulation ability of the STATCOM can be expanded to both reactive and active power compensation. The Active power control function can work faster than conventional synchronous generators and so, it has better performance. On the other hand, the reactive power control can enhance the power quality of the loads supplied by the consumers through the minimization of the voltage flicker and correction of the voltage sags. [3]

In this proposed scheme a FACTS device (STATCOM) is connected at a point of common coupling with a Optimal Li-Ion battery storage system (LIB) to reduce the power quality problems. The Optimal Li-ion battery energy storage system is integrated to support the real power source under fluctuating wind power. The Optimal LIB/STATCOM control scheme for the grid Interconnected wind energy generation system to improve the power quality is simulated using MATLAB/SIMULINK in Simpower system block set. The intended result of the proposed scheme relieves the main supply source from the reactive power demand of the load and the induction generator. From the obtained results, we have consolidated the feasibility and practicability of the approach for the applications considered. Finally the results with LIB/STATCOM, with STATCOM and without LIB and without LIB/STATCOM are compared and a mark reduction in total harmonic reduction is observed.

## II. Lithium Ion Battery

A lithium-ion battery is a rechargeable battery in which lithium ions move from the negative electrode to the positive electrode during discharge, and back when charging. Li-ion batteries use an intercalated lithium compound as the electrode material, compared to the metallic lithium used in the non-rechargeable lithium batteries.

**A. Construction**

The three primary functional components of a lithium-ion battery are the negative electrode, positive electrode, and the electrolyte. The negative electrode of a conventional lithium-ion cell is made from carbon. The positive electrode is a metal oxide, and the electrolyte is a lithium salt in an organic solvent. The electrochemical roles of the electrodes change between anode and cathode, depending on the direction of current flow through the cell.

The most popularly used negative electrode material is graphite. The positive electrode is generally one of three materials: a layered oxide (such as lithium cobalt oxide), a polyion (such as lithium iron phosphate), or a spinel (such as lithium manganese oxide).

The electrolyte is typically a mixture of organic carbonates such as ethylene carbonate or diethyl carbonate containing complexes of lithium ions. These non-aqueous electrolytes generally use non-coordinating anion salts such as lithium hexafluorophosphate (LiPF<sub>6</sub>), lithium hexafluoroarsenate monohydrate (LiAsF<sub>6</sub>), lithium perchlorate (LiClO<sub>4</sub>), lithium tetrafluoroborate (LiBF<sub>4</sub>), and lithium triflate (LiCF<sub>3</sub>SO<sub>3</sub>).

Depending on materials choices, the voltage capacity, life, and safety of a lithium-ion battery can change dramatically. Pure lithium is very reactive. It reacts vigorously with water to form lithium hydroxide and hydrogen gas. Thus, a non-aqueous electrolyte is typically used, and a sealed container rigidly excludes water from the battery pack [4].

**B. Characteristics**

High Output performance with standard discharge of 2C to 5C and continuous discharge high current capacity of up to 10C and the instantaneous discharge pulse up to 20C. Good performance is observed at high temperatures from 65 to 95 degree centigrade keeping the battery in good safe condition. It shows excellent life cycles as after 500 cycles also it shows discharge capacity to be above 95%. Even though during excessive discharge to zero volts there is no damage caused. It gets quickly charged with very less time as compared to other batteries. Cost is not very high and hence can be used for variety of applications. It's also environmental friendly battery which does not produce any waste.

**III. Topology for Power Quality Improvement**

The STATCOM based current control voltage source inverter injects the current into the grid in such a way that the source current are harmonic free and their phase-angle with respect to source voltage has a desired value. The injected current will cancel out the reactive part and harmonic part of the load and induction generator current, thus it improves the power factor and the power quality. To accomplish these goals, the grid voltages are sensed and are synchronized in generating the current command for the inverter. The proposed grid connected system is implemented for power quality improvement at point of common coupling (PCC), as shown in Fig. 1. [5]

The grid connected system in Fig. 1, consists of wind energy generation system and battery energy storage system with STATCOM.

**A. Wind Energy system**

In this configuration, wind generations are based on constant speed topologies with pitch control turbine. The induction generator is used in the proposed scheme because of its simplicity, it does not require a separate field circuit, it can accept constant and variable loads, and has natural protection against short circuit. The available power of wind energy system is presented as under in (1).

$$P_{wind} = \frac{1}{2} \rho A V_{wind}^3 \tag{1}$$

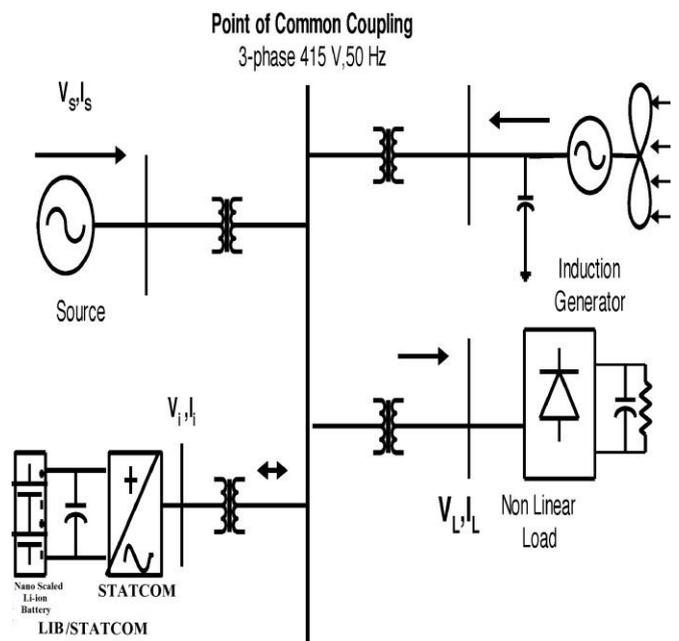


Fig. 1. Grid connected system for power quality improvement.

Where  $\rho$ (kg/m<sup>3</sup>) is the air density and A (m<sup>2</sup>) is the area swept out by the turbine blade,  $V_{wind}$  is the wind speed in mtr/s. It is not possible to extract all kinetic energy of wind, thus it extract a fraction of power in wind, called power coefficient  $C_p$  of the wind turbine, and is given in (2).

$$P_{mech} = C_p P_{wind} \tag{2}$$

where  $C_p$  is the power coefficient, depends on type and operating condition of wind turbine. This coefficient can be express as a function of tip speed ratio and pitch angle  $\theta$ . The mechanical power produce by wind turbine is given in (3)

$$P_{mech} = \frac{1}{2} \rho \pi R^2 V_{wind}^3 C_p \tag{3}$$

Where R is the radius of the blade (m).

**B. OPTIMAL LIB STATCOM:**

The Optimal(electrodes made-up of nano materials) Li-ion batteries are getting enormous attention as power sources and energy storage devices in Renewable energy system. The LIB will naturally maintain dc capacitor voltage constant and is best suited in STATCOM since it rapidly injects or absorbed reactive power to stabilize the grid system. It also

controls the distribution and transmission system in a very fast rate. When power fluctuation occurs in the system, the LIB can be used to level the power fluctuation by charging and discharging operation. The battery is connected in parallel to the dc capacitor of STATCOM [6]–[10].

The STATCOM is a three-phase voltage source inverter having the capacitance on its DC link and connected at the point of common coupling. The STATCOM injects a compensating current of variable magnitude and frequency component at the bus of common coupling.

The equivalent circuit model of the Li-ion battery is shown in Fig: 2

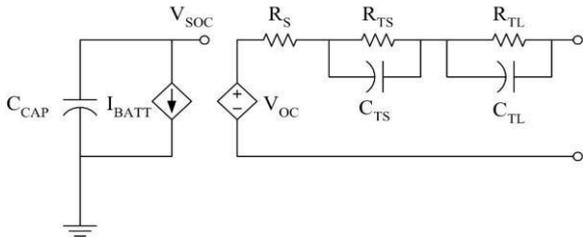


Fig: 2 Li-ion battery model

The ordinary differential equation for the Li-ion battery is shown as

$$\dot{\mathbf{x}} = \begin{bmatrix} 0 & 0 & 0 \\ 0 & -(R_{TS}C_{TS})^{-1} & 0 \\ 0 & 0 & -(R_{TL}C_{TL})^{-1} \end{bmatrix} \mathbf{x} + \begin{bmatrix} -C_{CAP}^{-1} \\ -C_{TS}^{-1} \\ -C_{TL}^{-1} \end{bmatrix} \mathbf{u} \quad (4)$$

$$\mathbf{y} = \mathbf{g}(\mathbf{x}_1) + \mathbf{x}_2 + \mathbf{x}_3 + R_S \mathbf{u} \quad (5)$$

The equation describes the circuit diagram above, where

- $R_{TS}$  and  $C_{TS}$  are the resistance and capacitance in the shorter time constant RC circuit,
- $R_{TL}$  and  $C_{TL}$  are the resistance and capacitance in the longer time constant RC circuit,
- $C_{CAP}$  represents the overall capacitance of the battery,
- $R_S$  is the series resistance, and
- $\mathbf{g}(\mathbf{x})$  is the non-linear function which maps  $V_{SOC}$  to  $V_{OC}$ .
- The state vector  $\mathbf{x}$  represents the voltages across  $C_{CAP}$ ,  $C_{TS}$ , and  $C_{TL}$ .
- The input  $\mathbf{u}$  is the current entering the battery, and
- The output  $\mathbf{y}$  is the voltage across the battery terminals

These  $R_{TS}$ ,  $C_{TS}$ ,  $R_{TL}$  and  $C_{TL}$  are calculated for the Optimal Battery.

### C. System Operation:

The shunt connected STATCOM with battery energy storage is connected with the interface of the induction generator and non-linear load at the PCC in the grid system. The STATCOM compensator output is varied according to the controlled strategy, so as to maintain the power quality norms in the grid system. The current control strategy is included in the control scheme that defines the functional operation of the STATCOM compensator in the power system. A single STATCOM using insulated gate bipolar transistor is proposed to have a reactive power support, to the induction generator and to the nonlinear load in the grid system. The

main block diagram of the system operational scheme is shown in Fig: 3

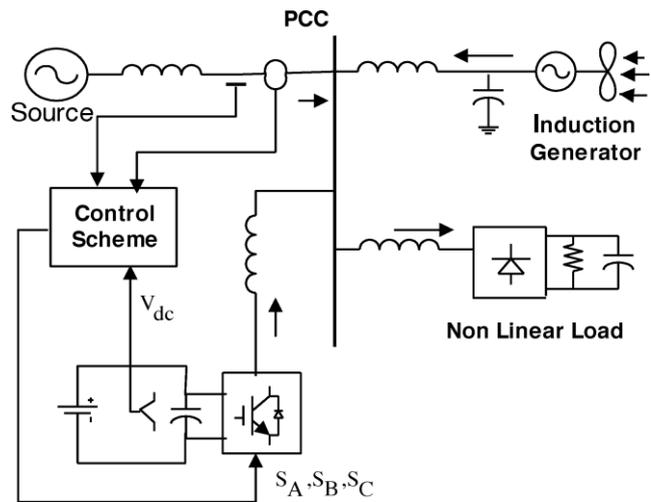


Fig: 3 System operational scheme in grid system.

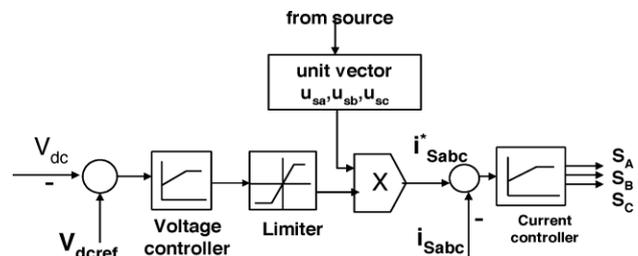


Fig: 4 Control system scheme

## iv. Control Scheme

The control scheme approach is based on injecting the currents into the grid using “bang-bang controller.” The controller uses a hysteresis current controlled technique. Using such technique, the controller keeps the control system variable between boundaries of hysteresis area and gives correct switching signals for STATCOM operation.

The control system scheme for generating the switching signals to the STATCOM is shown in Fig: 4

The control algorithm needs the measurements of several variables such as three-phase source current  $i_{Sabc}$ , DC voltage  $V_{dc}$ , inverter current  $i_{iabc}$  with the help of sensor. The current control block, receives an input of reference current  $i_{Sabc}^*$  and actual current  $i_{Sabc}$  are subtracted so as to activate the operation of STATCOM in current control mode [11]–[13].

### A. Grid Synchronization

In three-phase balance system, the RMS voltage source amplitude is calculated at the sampling frequency from the source phase voltage ( $V_{sa}$ ,  $V_{sb}$ ,  $V_{sc}$ ) and is expressed, as sample tem- plate  $V_{sm}$ , sampled peak voltage, as in (6).

$$V_{sm} = \left\{ \frac{2}{3} (V_{sa}^2 + V_{sb}^2 + V_{sc}^2) \right\}^{\frac{1}{2}} \quad (6)$$

The in-phase unit vectors are obtained from AC source—phase Voltage and the RMS value of unit vectors are shown in (7).

$$u_{sa} = \frac{V_{sa}}{V_{sm}}, u_{sb} = \frac{V_{sb}}{V_{sm}}, u_{sc} = \frac{V_{sc}}{V_{sm}} \quad (7)$$

The in-phase generated reference currents are derived using in-phase unit voltage template as, in (8).

$$i_{sa}^* = I \cdot u_{sa}, i_{sb}^* = I \cdot u_{sb}, i_{sc}^* = I \cdot u_{sc} \quad (8)$$

Where I is proportional to magnitude of filtered source voltage for respective phases. This ensures that the source current is controlled to be sinusoidal. The unit vectors implement the important function in the grid connection for the synchronization for STATCOM. This method is simple, robust and favorable as compared with other methods [13].

### B. Histerisis Controller

Hysteresis current controller is implemented in the current control scheme. The reference current is generated as in (7) and actual current are detected by current sensors and are subtracted for obtaining a current error for a hysteresis based bang-bang controller. Thus the ON/OFF switching signals for IGBT of STATCOM are derived from hysteresis controller [14].

The switching function  $S_A$  for phase ‘a’ is expressed as (9).

$$\begin{aligned} i_{sa} < (i_{sa}^* - HB) &\rightarrow S_A = 0 \\ i_{sa} > (i_{sa}^* + HB) &\rightarrow S_A = 1 \end{aligned} \quad (9)$$

where HB is a hysteresis current-band, similarly the switching function  $S_B, S_C$  can be derived for phases “b” and “c”.

## v. System Performance

The proposed control scheme is simulated using SIMULINK in power system block set. The system parameter for given system is given Table I.

The system performance of proposed system under dynamic Condition is also presented.

### A. Voltage Source Inverter

The three-phase injected current into the grid from STATCOM will cancel out the distortion caused by the non-linear load and wind generator. The IGBT based three-phase inverter is connected to grid through the transformer. The generation of switching signals from reference current is simulated within hysteresis band of 0.08. The choice of narrow hysteresis band switching in the system improves the current quality.

The choice of the current band depends on the operating voltage and the interfacing transformer impedance. The compensated current for the nonlinear load and demanded reactive power is provided by the inverter. The real power transfer from the batteries is also supported by the controller of this inverter. The three phase inverter injected current are shown in Fig: 5

2	Induction Motor/Generator	3.35KVA, 415V, 50Hz, P=4, Speed = 1440 rpm, Rs = 0.01Ω, Rr = 0.015Ω, Ls = 0.06H, Lr = 0.06H
3	Line Series Inductance	0.05mh
4	Inverter Parameters	DC Link Voltage = 800V, DV Link Capacitance = 100μF, Switching frequency = 2kHz
5	IGBT Rating	Collector Voltage = 12000V, Forward current = 50A, Gate Voltage =20V, Power dissipation = 310W
6	Load parameter	Non-linear Load = 25kW.

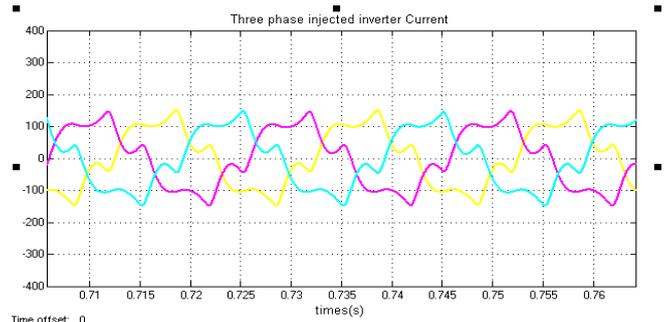


Fig: 5 Three phase injected inverter Current.


### B. STATCOM – Performance under load variation

The wind energy generating system is connected with grid having the nonlinear load. The performance of the system is measured by switching the STATCOM at time = 0.7s in the system and how the STATCOM responds to the step change command for increase in additional load at 1.0 s is shown in the simulation. When STATCOM controller is made ON, without change in any other load condition parameters, it starts to mitigate for reactive demand as well as harmonic current. The dynamic performance is also carried out by step change in a load, when applied at 1.0 s. This additional demand is fulfill by STATCOM compensator. Thus, STATCOM can regulate the available real power from source. The results of source current, load current are shown in Fig: 6(a) and (b) respectively. While the results of injected current from STATCOM are shown in Fig. 6(c) and the generated current from wind generator at PCC are depicted in Fig. 5(d).


The DC link voltage regulates the source current in the grid system, so the DC link voltage is maintained constant across the capacitor as shown in Fig: 7 (a). The current through the dc link capacitor indicating the charging and discharging operation as shown in Fig: 7 (b).

TABLE I SYSTEM PARAMETERS


S.NO	Parameters	Rating
1	Grid Voltage	3-phase, 415V, 50Hz

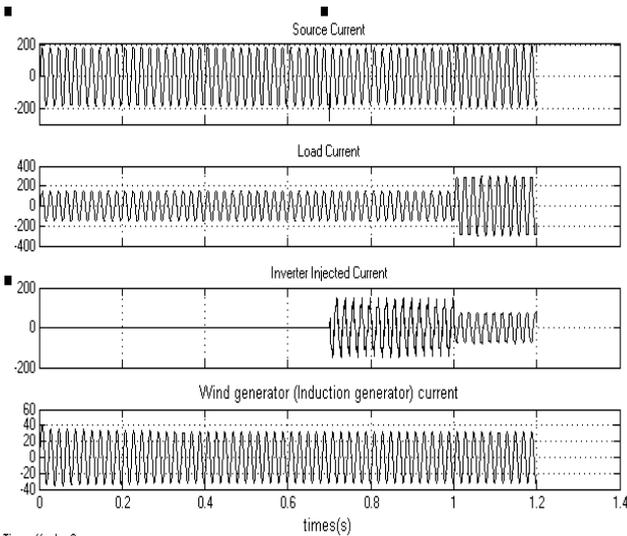


Time offset: 0  
Fig: 6 (a) Source Current. (b) Load Current. (c) Inverter Injected Current. (d) Wind generator (Induction generator) current

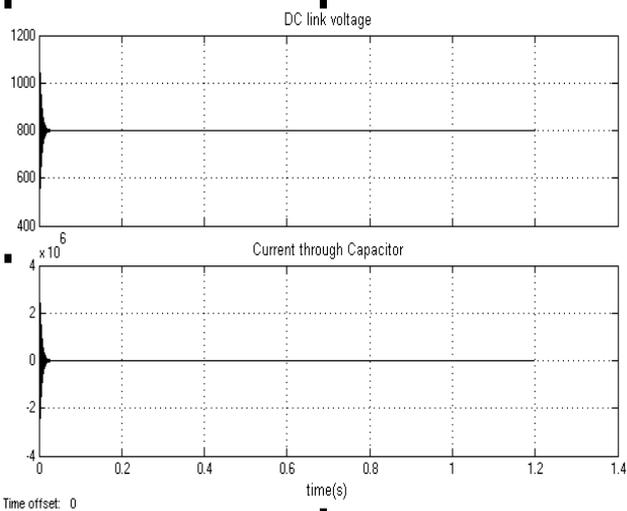

Time offset: 0  
Fig: 7 (a) DC link voltage. (b) Current through Capacitor.

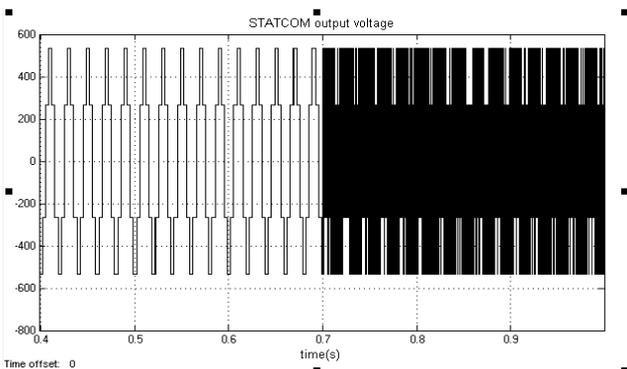

Time offset: 0  
Fig: 8 STATCOM output voltage

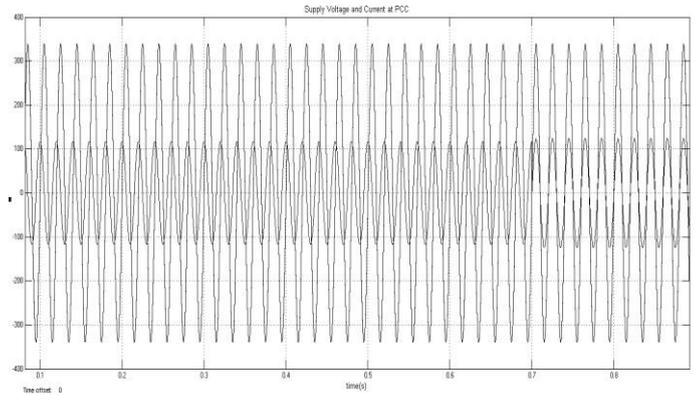

Time offset: 0  
Fig: 9 Supply Voltage and Current at PCC

**C. Power quality improvement by Optimal LIB/STATCOM:**

It is observed that the source current on the grid is affected due to the effects of nonlinear load and wind generator, thus purity of waveform may be lost on both sides in the system. The inverter output voltage under STATCOM operation with load variation is shown in Fig: 8. The power factor is improve can be seen in Fig: 9. The dynamic load does affect the inverter output voltage. From FFT analysis, it is observed that in Fig: 10 the Total Harmonic Distortion (THD) of the source current waveform of the test system without Li-BS STATCOM is 5.36%.

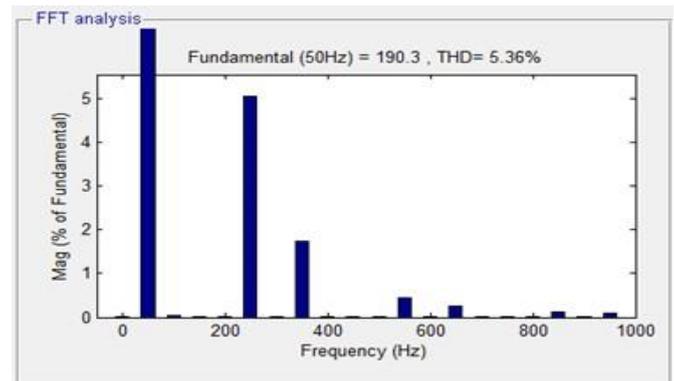


Fig: 10 THD of source current without Optimal LIB/STATCOM

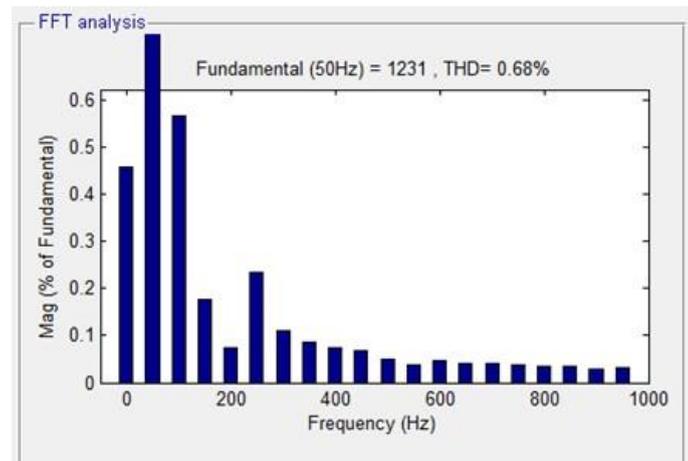


Fig: 11 THD of source current with PSO LIB/STATCOM

Form Fig: 11 the THD of source current of test system with PSO Based Li-BS STATCOM is 0.68%.

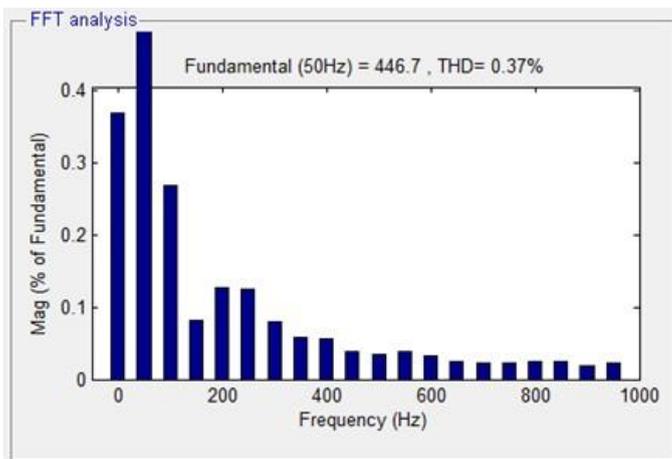


Fig: 12 THD of source current with BATS LIB/STATCOM

Form Fig: 12 the THD of source current of test system with BATS Based Li-BS STATCOM is 0.37%

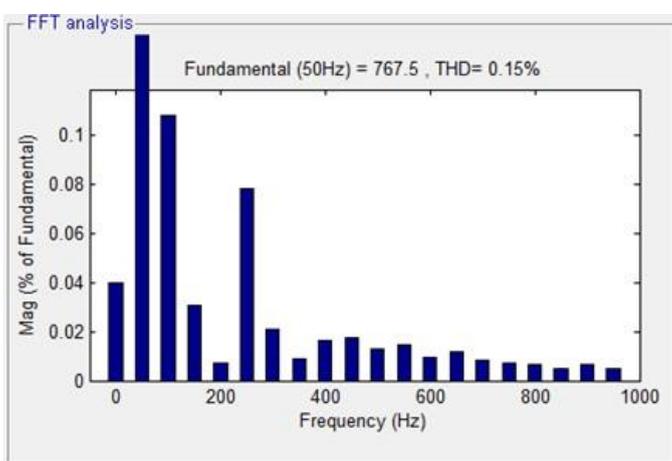


Fig: 13 THD of source current with TLBO LIB/STATCOM

Form Fig: 13 the THD of source current of test system with TLBO Based Li-BS STATCOM is 0.15%

Hence from the FFT analysis it is observed that the mark reduction in THD for Li-BS STATCOM.

## VI. Conclusion

In this paper Optimal Lithium ion energy storage battery based STATCOM is presented for grid connected Wind Energy Generating System. The proposed Optimal LIB/STATCOM have improved the power quality of source current significantly by reducing the THD from 5.36% to 0.15%. It is clearly presented that STATCOM with Optimal LIB gives better performance than STATCOM without LIB.

## REFERENCES

[1] J Molenda, Material Problems and Prospects Of Li-ion Batteries for vehicles applications. World scientific-2011

[2] D. Ra and K. S. Han, "Used lithium ion rechargeable battery recycling using Etoile-Rebatt technology", Journal of Power Sources, Elsevier, vol. 163, 2006 pages. 284-288.

[3] R. Kuiava, R. A. Ramos, N. G. Bretas, "Control Design of a STATCOM with Energy Storage System for Stability and Power Quality" Industrial Technology, 2009. ICIT 2009, pp: 1-6.

[4] Karen L. Butler, Mehrdad Ehsani, Preyas Kamath, "Matlab-Based Modeling and Simulation Package for Electric and Hybrid Electric Vehicle Design", published in IEEE transactions on vehicular technology, vol. 48, no. 6, pp. 1770-1778, November 1999.

[5] S. W. Mohod and M. V. Aware, "A STATCOM-Control Scheme for Grid Connected Wind Energy System for Power Quality Improvement", Published in. Systems Journal, IEEE (Volume:4 , Issue: 3 ), pp. 346-352, sept 2010.

[6] Chen, Min, and G. A. Rincon-Mora. 2006. Accurate electrical battery model capable of predicting runtime and I-V performance. IEEE Transactions on Energy Conversion 21 (2):504-511.

[7] Schweighofer, B., K. M. Raab, and G. Brasseur. 2003. Modeling of high power automotive batteries by the use of an automated test system. IEEE Transactions on Instrumentation and Measurement 52 (4):1087-1091.

[8] Tremblay, O. Dessaint, L.-A. "Experimental Validation of a Battery Dynamic Model for EV Applications." World Electric Vehicle Journal. Vol. 3 - ISSN 2032-6653 - © 2009 AVERE, EVS24 Stavanger, Norway, May 13 - 16, 2009.

[9] T. Kinjo and T. Senjyu, "Output leveling of renewable energy by electric double layer capacitor applied for energy storage system," *IEEE Trans. Energy Conv.*, vol. 21, no. 1, Mar. 2006.

[10] R. S. Bhatia, S. P. Jain, D. K. Jain, and B. Singh, "Battery energy storage system for power conditioning of renewable energy sources," in *Proc. Int. Conf. Power Electron Drives System*, Jan. 2006, vol. 1, pp.501-506.

[11] Fu. S. Pai and S.-I. Hung, "Design and operation of power converter for microturbine powered distributed generator with capacity expansion capability," *IEEE Trans. Energy Conv.*, vol. 3, no. 1, pp. 110-116, Mar.2008.

[12] J. Zeng, C. Yu, Q. Qi, and Z. Yan, "A novel hysteresis current control for active power filter with constant frequency," *Elect. Power Syst. Res.*, vol. 68, pp. 75-82, 2004.

[13] M. I. Milands, E. R. Cadavai, and F. B. Gonzalez, "Comparison of control strategies for shunt active power filters in three phase four wire system," *IEEE Trans. Power Electron.*, vol. 22, no. 1, pp. 229-236, Jan.2007.

[14] S. W. Mohod and M. V. Aware, "Power quality issues & it's mitigation technique in wind energy conversion," in *Proc. of IEEE Int. Conf. Quality Power & Harmonic*, Wollongong, Australia, 2008.

## AUTHORS' PROFILE



Ch. Sri Mrudula - Obtained B.Tech degree in Electrical and Electronics Engineering from Padma Shri Dr. B V. Raju Institute of Technology, Narsapur, Medak District, Telangana, India in 2018. At present, she is pursuing M.Tech degree in Electrical Power Systems from St. Peter's Engineering College, Maisammaguda, Hyderabad, Telangana, India.



Dr. K. Sreelatha - Obtained PhD in Power Systems from JNTU Anantapur, India in 2018. At present, she is the Head of the Department of Electrical and Electronics Engineering at St. Peter's Engineering College, Maisammaguda, Hyderabad, India. Her research interests include Renewable Energy Systems and Power Quality. She has 7 publications in international and 2 publications in national journals. She has 2 publications in international and 3 publications in national conferences.